


BMID Turbidity August 2021

(Single Point Daily Sampling with Inline Hach 1720c)

WQA

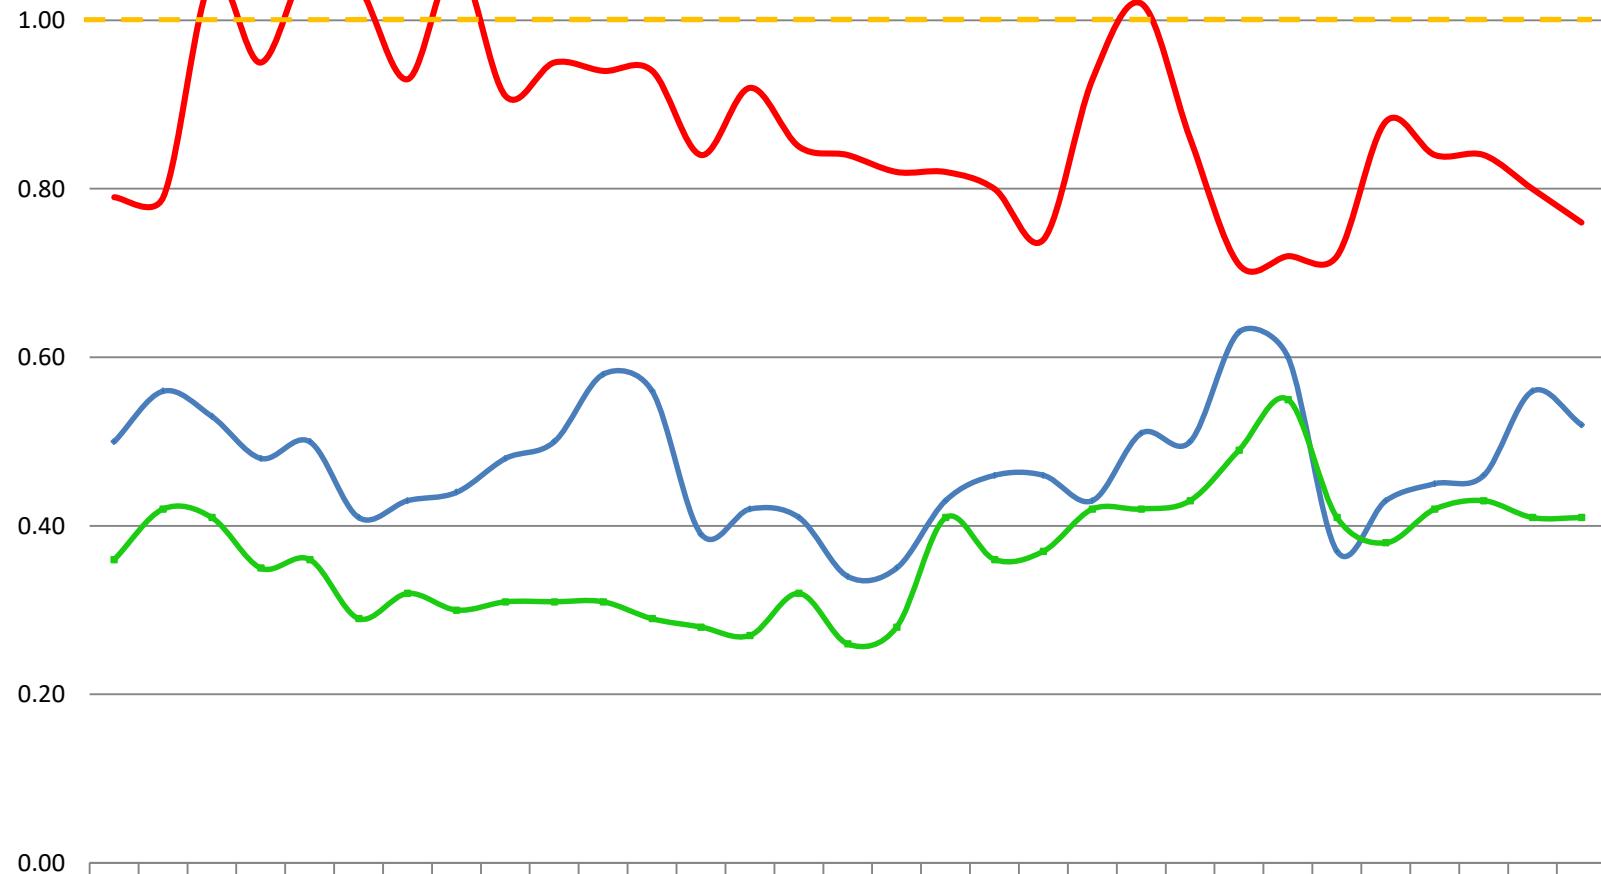

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Distribution Intake	0.5	0.5	0.5	0.4	0.5	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.3	0.4	0.4	0.3	0.3	0.4	0.4	0.4	0.4	0.5	0.5	0.6	0.6	0.3	0.4	0.4	0.5	0.5	
Booster#1- First User	0.3	0.4	0.4	0.3	0.3	0.2	0.3	0.3	0.3	0.3	0.3	0.2	0.2	0.2	0.3	0.2	0.2	0.2	0.4	0.3	0.3	0.4	0.4	0.4	0.4	0.5	0.4	0.3	0.4	0.4	
Mission Creek Intake	0.7	0.7	1.0	0.9	1.0	1.0	0.9	1.0	0.9	0.9	0.9	0.8	0.9	0.8	0.8	0.8	0.8	0.8	0.7	0.9	1.0	0.8	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.7	

— Distribution Intake

— Booster#1- First User

— Mission Creek Intake